

ACCESSIBILITY NOTES:

1. ACCESS TO BUILDING FOR PERSONS IN WHEELCHAIRS IS DESIGNED BY AND FIELD BUILT BY OTHERS AND SUBJECT TO LOCAL JURISDICTION. THE PRIMARY ENTRANCE MUST BE ACCESSIBLE. ALL BUILDING ELEMENTS AND FACILITIES SHALL BE ACCESSIBLE IN ACCORDANCE WITH THE REFERENCE ACCESSIBILITY STANDARDS EXCEPT WHERE SPECIFICALLY EXEMPTED BY THE SCOPING REQUIREMENTS OF THE APPLICABLE CODE.
2. THE INTERNATIONAL SYMBOL OF ACCESSIBILITY SIGN SHALL BE DISPLAYED AT ALL ACCESSIBLE RESTROOM FACILITIES AND AT ACCESSIBLE BUILDING ENTRANCES UNLESS ALL ENTRANCES ARE ACCESSIBLE. INACCESSIBLE ENTRANCES SHALL HAVE DIRECTIONAL SIGNS INDICATING THE ROUTE TO THE NEAREST ACCESSIBLE ENTRANCE. AT LEAST ONE OF ALL PUBLIC ENTRANCES MUST BE ACCESSIBLE.
3. ACCESSIBLE DRINKING FOUNTAINS SHALL HAVE A SPOUT OUTLET HEIGHT NO HIGHER THAN 36 INCHES ABOVE THE FLOOR AND SPOUT SHALL BE LOCATED 15 INCHES MINIMUM FROM THE VERTICAL SUPPORT AND 3 INCHES MAXIMUM FROM THE FRONT EDGE OF THE UNIT, INCLUDING BUMPERS. SPOUT SHALL PROVIDE A FLOW OF WATER 4 INCHES HIGH MINIMUM. ANGLE OF WATER STREAM SHALL BE IN ACCORDANCE WITH THE APPLICABLE ACCESSIBILITY CODE. DRINKING FOUNTAINS FOR STANDING PERSONS SHALL HAVE A SPOUT OUTLET HEIGHT 36 INCHES MINIMUM AND 43 INCHES MAXIMUM ABOVE THE FLOOR.
4. WHERE STORAGE FACILITIES SUCH AS CABINETS, SHELVES, CLOSETS, AND DRAWERS ARE PROVIDED AT LEAST ONE OF EACH TYPE PROVIDED SHALL CONTAIN STORAGE SPACE COMPLYING WITH THE FOLLOWING: DOORS, ETC. TO SUCH SPACES SHALL BE ACCESSIBLE (I.E. TOUCH LATCHES, U-SHAPED PULLS); FOR AREAS WITH UNOBSTRUCTED REACH THE SPACE SHALL BE WITHIN 15 INCHES MINIMUM AND 48 INCHES MAXIMUM OF THE FLOOR; FOR HIGH FORWARD REACH AREAS WITH OBSTRUCTIONS THE CLEAR FLOOR SPACE SHALL EXTEND BENEATH THE ELEMENT FOR A DISTANCE NOT LESS THAN THE REQUIRED REACH DEPTH OVER THE OBSTRUCTION AND THE HEIGHT OF THE SPACE SHALL BE 48 INCHES MAXIMUM AND THE DEPTH OF THE SPACE SHALL BE 20 INCHES MAXIMUM EXCEPT THE DEPTH MAY BE 25 INCHES MAXIMUM IF THE HEIGHT IS 44 INCHES MAXIMUM FOR HIGH-REACH AREAS WITH OBSTRUCTIONS THE HEIGHT OF THE OBSTRUCTION SHALL BE 34 INCHES MAXIMUM AND THE DEPTH OF THE OBSTRUCTION SHALL BE 24 INCHES MAXIMUM AND IF THE REACH DEPTH EXCEEDS 10 INCHES THEN THE MAXIMUM REACH HEIGHT IS 48 INCHES; EXCEPT THE HEIGHT OF WASHING MACHINES AND DRYERS MAY BE 36 INCHES MAXIMUM.
5. CONTROLS, DISPENSERS, RECEPTACLES AND OTHER OPERABLE EQUIPMENT SHALL BE NO HIGHER THAN THE REACH HEIGHTS SPECIFIED IN NOTE 4 ABOVE AND NO LESS THAN 15 INCHES ABOVE THE FLOOR. EXCEPTION: HEIGHT LIMITATIONS DO NOT APPLY WHERE THE USE OF SPECIAL EQUIPMENT INDICATES OTHERWISE OR WHERE ELECTRICAL RECEPTACLES ARE NOT NORMALLY INTENDED FOR USE BY BUILDING OCCUPANTS.
6. WHERE EMERGENCY WARNING SYSTEMS ARE PROVIDED, THEY SHALL INCLUDE BOTH AUDIBLE AND VISUAL ALARMS. THE VISUAL ALARMS SHALL BE LOCATED THROUGHOUT, INCLUDING RESTROOMS, AND PLACED 80 INCHES ABOVE THE FLOOR OR 6 INCHES BELOW CEILING, WHICHEVER IS LOWER.
7. DOORS TO ALL ACCESSIBLE SPACES SHALL HAVE ACCESSIBLE HARDWARE (I.E. LEVER-OPERATED, PUSH-TYPE, U-SHAPED) MOUNTED NO HIGHER THAN 48 INCHES ABOVE THE FLOOR.
8. FLOOR SURFACES SHALL BE STABLE, FIRM, AND SLIP-RESISTANT. CHANGES IN LEVEL BETWEEN 0.25 INCH AND 0.5 INCH SHALL BE BEVELED WITH A SLOPE NO GREATER THAN 1:2. CHANGES IN LEVEL GREATER THAN 0.5 INCH REQUIRE RAMP. CARPET PILE THICKNESS SHALL BE 0.5 INCH MAX. CRACKS IN FLOOR SHALL BE SPACED NO GREATER THAN 0.5 INCH WIDE IN ONE DIRECTION. DOORWAY THRESHOLDS SHALL NOT EXCEED 0.5 INCH IN HEIGHT.
9. ALL DOORS SHALL BE OPENABLE BY A SINGLE EFFORT. THE MAXIMUM FORCE REQUIRED TO OPEN A DOOR SHALL NOT EXCEED 8.5 LBS. FOR EXTERIOR SWINGING DOORS AND 5 LBS. FOR ALL SLIDING, FOLDING, AND INTERIOR SWINGING DOORS.
10. DOORS AND SIDELITES ADJACENT TO DOORS CONTAINING ONE OR MORE GLAZING PANELS THAT PERMIT VIEWING THROUGH THE PANELS SHALL HAVE THE BOTTOM OF AT LEAST ONE PANEL ON EITHER THE DOOR OR AN ADJACENT SIDELITE 43 INCHES MAXIMUM ABOVE THE FLOOR. VISION LITES WITH THE LOWEST PART MORE THAN 66 INCHES ABOVE THE FLOOR ARE EXEMPT FROM THIS REQUIREMENT.
11. THIS BUILDING IS DESIGNED FOR USE AS A PRIVATE OFFICE WORK AREA ONLY AND IS NOT INTENDED FOR USE BY OR SERVICE TO THE GENERAL PUBLIC.
12. ACCESSIBLE WATER CLOSETS SHALL BE 17 INCHES TO 19 INCHES FROM THE FLOOR TO THE TOP OF THE SEAT. GRAB BARS SHALL BE 36 INCHES LONG MINIMUM WHEN LOCATED BEHIND WATER CLOSET AND 42 INCHES LONG MINIMUM WHEN LOCATED ALONG SIDE OF WATER CLOSET. GRAB BARS SHALL BE MOUNTED AT 33 INCHES TO 36 INCHES FROM THE FLOOR TO THE CENTERLINE OF THE BAR. SIDE WALL GRAB BARS SHALL BE MOUNTED WITH THE FAR END LOCATED A MAXIMUM OF 12 INCHES FROM THE WALL BEHIND THE WATER CLOSET. THE REAR GRAB BAR IS PERMITTED TO BE 24 INCHES LONG MINIMUM, CENTERED BEHIND THE WATER CLOSET. WHERE WALL SPACE DOES NOT PERMIT A GRAB BAR 36 INCHES LONG DUE TO LOCATION OF A RECESSED FIXTURE ADJACENT TO THE WATER CLOSET, THE CENTERLINE OF WATER CLOSETS SHALL BE 16 INCHES MINIMUM AND 18 INCHES MAXIMUM FROM THE SIDE WALL OR PARTITION, EXCEPT THE WATER CLOSET SHALL BE 17 INCHES MINIMUM AND 19 INCHES MAXIMUM FROM THE SIDE WALL OR PARTITION IN AMBULATORY ACCESSIBLE TOILET COMPARTMENTS.
13. IF 03 OR 09 ANSI A117.1 IS SHOWN UNDER ACCESSIBILITY IN THE CODE SUMMARY, A VERTICAL GRAB BAR 18 INCHES MINIMUM IN LENGTH SHALL BE LOCATED ON THE SIDE WALL ADJACENT TO THE WATER CLOSET DIRECTLY ABOVE THE 42 INCH LONG HORIZONTAL GRAB BAR. THE VERTICAL BAR SHALL BE MOUNTED WITH THE BOTTOM OF THE BAR LOCATED BETWEEN 39 INCHES AND 41 INCHES ABOVE THE FLOOR, AND WITH THE CENTERLINE OF THE BAR LOCATED BETWEEN 39 INCHES AND 41 INCHES FROM THE REAR WALL.
14. ACCESSIBLE URINALS SHALL BE STALL-TYPE OR WALL HUNG WITH ELONGATED RIMS AT A MAXIMUM OF 17 INCHES ABOVE THE FLOOR AND 13.5 INCHES FROM THE WALL.
15. ACCESSIBLE LAVATORIES AND SINKS SHALL BE MOUNTED WITH THE RIM NO HIGHER THAN 34 INCHES ABOVE THE FLOOR AND A CLEARANCE OF AT LEAST 27 INCHES HIGH AND 30 INCHES WIDE. KNEE CLEARANCE SHALL BE 11 INCHES MINIMUM IN DEPTH AT 9 INCHES ABOVE THE FLOOR, AND 8 INCHES MINIMUM IN DEPTH AT 27 INCHES ABOVE THE FLOOR. BETWEEN 9 INCHES AND 27 INCHES ABOVE THE FLOOR, KNEE CLEARANCE SHALL BE PERMITTED TO BE REDUCED AT A RATE OF 1 INCH IN DEPTH FOR EACH 8 INCHES IN HEIGHT.
16. HOT WATER AND DRAIN PIPES UNDER ACCESSIBLE LAVATORIES AND SINKS SHALL BE INSULATED OR OTHERWISE CONFIGURED TO PROTECT AGAINST CONTACT. INSULATION OR PROTECTION MATERIALS MAY BE SITE INSTALLED. THERE SHALL BE NO SHARP OR ABRASIVE SURFACES UNDER ACCESSIBLE LAVATORIES AND SINKS.
17. ACCESSIBLE LAVATORIES AND SINKS SHALL HAVE ACCESSIBLE FAUCETS (I.E. LEVER-OPERATED, PUSH-TYPE, ELECTRONICALLY CONTROLLED).
18. WHERE MIRRORS ARE LOCATED ABOVE LAVATORIES, A MIRROR SHALL BE LOCATED OVER THE ACCESSIBLE LAVATORY AND SHALL BE MOUNTED WITH THE BOTTOM EDGE OF THE REFLECTING SURFACE 40 INCHES MAXIMUM ABOVE THE FLOOR. WHERE MIRRORS ARE LOCATED ABOVE COUNTERS THAT DO NOT CONTAIN LAVATORIES, THE MIRROR SHALL BE MOUNTED WITH THE BOTTOM EDGE OF THE REFLECTING SURFACE 40 INCHES MAXIMUM ABOVE THE FLOOR.
19. GRAB BARS REQUIRED FOR ACCESSIBILITY SHALL BE 1.25 INCH TO 2 INCHES IN DIAMETER WITH 1.5 INCHES OF CLEAR SPACE BETWEEN THE BAR AND THE WALL.
20. TOILET PAPER DISPENSERS SHALL BE INSTALLED 7 INCHES MINIMUM AND 9 INCHES MAXIMUM IN FRONT OF THE WATER CLOSET MEASURED TO THE CENTERLINE OF THE DISPENSER. THE OUTLET OF THE DISPENSER SHALL BE 18 INCHES MINIMUM AND 48 INCHES MAXIMUM ABOVE THE FINISH FLOOR AND SHALL NOT BE LOCATED BEHIND GRAB BARS. WHERE THE DISPENSER IS LOCATED ABOVE THE GRAB BAR, THE OUTLET OF THE DISPENSER SHALL BE LOCATED WITHIN AN AREA 24 INCHES MINIMUM AND 38 INCHES MAXIMUM FROM THE REAR WALL AND THE DISPENSER SHALL BE 12 INCHES CLEAR FROM THE TOP OF THE GRAB BAR. WHEN THE DISPENSER IS LOCATED BELOW THE GRAB BAR, THE OUTLET OF THE DISPENSER SHALL BE LOCATED IN AN AREA 24 INCHES MINIMUM AND 42 INCHES MAXIMUM FROM THE REAR WALL AND THE DISPENSER SHALL BE 1.5 INCHES CLEAR FROM THE BOTTOM OF THE GRAB BAR. DISPENSERS THAT CONTROL DELIVERY, OR THAT DO NOT PERMIT CONTINUOUS FLOW, SHALL NOT BE USED.
21. WATER CLOSET FLUSH CONTROL SHALL BE MOUNTED ON THE WIDE SIDE OF THE TOILET AREA.
22. A TOWEL DISPENSER SHALL BE LOCATED ADJACENT TO ALL ACCESSIBLE LAVATORIES.
23. THE SHOWER SEAT SHALL BE MOUNTED 17 INCHES TO 19 INCHES FROM THE BATHROOM FLOOR AND SHALL EXTEND THE FULL DEPTH OF THE STALL.
24. A SHOWER SPRAY UNIT WITH A HOSE AT LEAST 60 INCHES LONG THAT CAN BE USED BOTH AS A FIXED SHOWER HEAD AND AS A HAND-HELD SHOWER SHALL BE PROVIDED. SHOWER SPRAY CONTROL SHALL BE EQUIPPED WITH AN ON/OFF SWITCH AND SHALL LIMIT TEMPERATURE TO 110°F (43°C).
25. CURBS IN SHOWER STALLS BE NO HIGHER THAN 1/2 INCH.
26. ENCLOSURES FOR SHOWER STALLS SHALL NOT OBSTRUCT CONTROLS OR OBSTRUCT TRANSFER FROM WHEELCHAIRS ONTO SHOWER SEATS.
27. WHERE 3 OR FEVER WASHING MACHINES ARE PROVIDED, AT LEAST ONE SHALL BE ACCESSIBLE. WHERE MORE THAN 3 WASHING MACHINES ARE PROVIDED, AT LEAST ONE SHALL BE ACCESSIBLE. TOP LOADING MACHINES SHALL HAVE DOOR TO LAUNDRY COMPARTMENT LOCATED 36 INCHES MAXIMUM ABOVE THE FINISH FLOOR. FRONT LOADING MACHINES SHALL HAVE THE BOTTOM OF THE OPENING TO THE LAUNDRY COMPARTMENT LOCATED 15 INCHES MINIMUM AND 42 INCHES MAXIMUM FROM THE REAR WALL AND THE OPERABLE PARTS SHALL BE 5 POUNDS MAXIMUM. OPERABLE PARTS SHALL BE LOCATED WITHIN THE REACHING RANGES SPECIFIED ABOVE.

GENERAL NOTES:

1. ALL CONSTRUCTION, MATERIALS, AND INSTALLATION SHALL BE IN ACCORDANCE WITH THE CODES SPECIFIED ON THESE DRAWINGS.
2. THESE PLANS INCLUDE DESIGN FOR THE FACTORY BUILT PORTION OF THE MODULAR STRUCTURE AND PORTIONS OF THE SITE BUILT CONSTRUCTION. THESE PLANS AND DESIGN PLANS FOR ALL ELEMENTS DESIGNATED TO BE DESIGNED BY OTHERS AND/OR SITE INSTALLED MUST BE SUBMITTED TO AND REVIEWED BY THE DESIGN PROFESSIONAL IN RESPONSIBLE CHARGE (DESIGNER OF RECORD) FOR COMPATIBILITY WITH THE DESIGN OF THE OVERALL BUILDING PROJECT AS REQUIRED BY THE APPLICABLE CODES AND LAWS.
3. ALL PARTIES RESPONSIBLE FOR DESIGN WORK SHALL BE QUALIFIED AND LICENSED AS REQUIRED BY THE JURISDICTIONS HAVING AUTHORITY OR SHALL RETAIN SUCH QUALIFIED AND LICENSED ENTITIES TO PERFORM SUCH WORK.
4. TRANSPORTATION AND ERECTION OF THIS BUILDING IS DESIGNED BY OTHERS. ANY TRANSPORTATION AND/OR LIFTING ELEMENTS SHOWN IN THESE PLANS MUST BE EVALUATED BY TRANSPORTATION AND ERECTION DESIGNER FOR SUITABILITY.
5. REFER TO MANUFACTURER'S APPROVED SYSTEMS PACKAGE FOR ADDITIONAL CONSTRUCTION DETAILS AND SPECIFICATIONS NOT INCLUDED IN THESE PLANS.
6. REFER TO ATTACHED ENERGY CODE COMPLIANCE FORM AND/OR HEAT LOSS AND GAIN CALCULATIONS FOR ADDITIONAL ENERGY CODE CONSTRUCTION REQUIREMENTS NOT INCLUDED IN THESE PLANS.
7. ALL DOORS SHALL BE OPENABLE FROM THE EGRESS SIDE WITHOUT THE USE OF A KEY, TOOL, SPECIAL KNOWLEDGE OR EFFORT. MANUALLY OPERATED FLUSH BOLTS OR SURFACE BOLTS SHALL NOT BE USED.
8. WHEN NOT SHOWN ON THE PLANS PROVISIONS FOR EXIT DISCHARGE LIGHTING (INCLUDING DUAL ELEMENT EXIT DISCHARGE EMERGENCY LIGHTING) ARE DESIGNED BY OTHERS AND THE RESPONSIBILITY OF THE BUILDING OWNER AND SUBJECT TO LOCAL JURISDICTION APPROVAL.
9. PORTABLE FIRE EXTINGUISHERS SHALL BE PROVIDED BY OTHERS AS REQUIRED BY THE LAW.
10. ALL GLAZING WITHIN A 24 INCH ARC OF DOORS WHOSE BOTTOM EDGE IS LESS THAN 60 INCHES ABOVE THE FLOOR AND ALL GLAZING IN DOORS SHALL BE SAFETY, TEMPERED, OR ACRYLIC PLASTIC SHEET.
11. DOORS THAT OPEN INTO THE PATH OF EGRESS TRAVEL SHALL PARTIALLY OR FULLY OPEN IN SUCH A MANNER THAT THE CODE REQUIRED PATH OF EGRESS WIDTH IS NOT REDUCED TO LESS THAN ONE-HALF DURING THE COURSE OF THE SWING. WHEN FULLY OPEN, THE DOOR SHALL NOT PROJECT MORE THAN 7 INCHES INTO THE CODE REQUIRED WIDTH.
12. INTERIOR NON-LOADBEARING PARTITIONS SHALL BE MINIMUM 2X4 SPF#3 STUDS AT 16 INCHES ON CENTER.
13. THIS BUILDING SHALL NOT BE INSTALLED AT ANY LOCATION WHERE THE SNOW LOAD AS DETERMINED FROM LOCAL METEOROLOGICAL DATA EXCEEDS THE SNOW LOAD LISTED ON THESE PLANS.
14. IF THIS BUILDING IS LOCATED IN A WIND BORNE DEBRIS REGION ALL EXTERIOR GLAZING SHALL BE PROTECTED WITH AN IMPACT RESISTANT COVERING WHICH IS ALSO DESIGNED TO RESIST THE APPLICABLE WIND PRESSURES. THIS COVERING IS DESIGNED BY OTHERS, SITE INSTALLED AND SUBJECT TO LOCAL JURISDICTION APPROVAL. WIND BORNE DEBRIS REGIONS INCLUDE THE FOLLOWING:
A. AREAS WITHIN ONE MILE OF THE COASTAL MEAN HIGH WATER LINE WHERE THE BASIC WIND SPEED IS EQUAL TO OR GREATER THAN 110 MPH, OR
B. AREAS WHERE THE BASIC WIND SPEED IS EQUAL TO OR GREATER THAN 120 MPH.
15. WHERE CORRIDORS ARE PROVIDED THE MINIMUM CORRIDOR WIDTH SHALL BE AS SHOWN ON THESE PLANS OR 44 INCHES, WHICHEVER IS GREATER.
16. WHERE CORRIDORS ARE PROVIDED THE MINIMUM CORRIDOR FINISH SHALL BE CLASS B.

SITE INSTALLED ITEMS:

- NOTE THAT THIS LIST DOES NOT NECESSARILY LIMIT THE ITEMS OF WORK AND MATERIALS THAT MAY BE REQUIRED FOR A COMPLETE INSTALLATION. ALL SITE RELATED ITEMS ARE SUBJECT TO LOCAL JURISDICTION APPROVAL.
1. THE COMPLETE FOUNDATION SUPPORT AND TIE DOWN SYSTEM.
 2. RAMPS, STAIRS AND GENERAL ACCESS TO THE BUILDING.
 3. PORTABLE FIRE EXTINGUISHER(S).
 4. BUILDING DRAINS, CLEANOUTS, AND HOOK-UP TO THE PLUMBING SYSTEM.
 5. ELECTRICAL SERVICE HOOK-UP (INCLUDING FEEDERS) TO THE BUILDING.
 6. THE MAIN ELECTRICAL PANEL AND SUB-FEEDERS.
 7. CONNECTIONS OF ELECTRICAL CIRCUITS CROSSING OVER MODULE MATING LINES(S) - (MULTI-UNITS ONLY).
 8. DUAL ELEMENT EXTERIOR EXIT DISCHARGE LIGHTING WHEN NOT SHOWN ON PLANS.
 9. STRUCTURAL AND AESTHETIC INTERCONNECTIONS BETWEEN MODULES (MULTI-UNITS ONLY).
 10. EXTERIOR GLAZING PROTECTION.
 11. GUTTERS & DOWN SPOUTS WHEN REQUIRED.
 12. WATER HEATER THERMAL EXPANSION DEVICE WHEN REQUIRED.
 13. PROGRAMMABLE THERMOSTATS IF NOT INSTALLED AT FACTORY.
 14. DRINKING FOUNTAIN & SERVICE SINK WHEN NOT SHOWN ON FLOOR PLAN.
 15. ALL SIGNS UNLESS OTHERWISE SPECIFIED.
 16. ANY AIR GAPS BETWEEN MODULES AT FLOOR AND CEILING LINES AND ANY OTHERS PENETRATIONS THROUGH THE BUILDING ENVELOPE SHALL BE CAULKED, GASKETED, WEATHER-STRIPPED, WRAPPED OR OTHERWISE SEALED TO LIMIT UNCONTROLLED AIR MOVEMENT.

WINDOW AND DOOR ABBREVIATIONS:

3680 = 36 INCHES X 80 INCHES (TYPICAL)

VS = VERTICAL SLIDER, SINGLE OR DOUBLE HUNG

ST/ST = STEEL INSULATED DOOR

V/B = VIEW BLOCK

FOUNDATION NOTE:

FOR FOUNDATION DESIGN REFER TO THE ATTACHED FOUNDATION PLANS PREPARED BY THE BUILDING DESIGNER. IF FOUNDATION PLANS ARE DESIGNED BY OTHERS, THE BUILDING DESIGNER SHALL NOT BE HELD RESPONSIBLE OR LIABLE FOR THE FOUNDATION DESIGN & THE CONSEQUENTIAL PERFORMANCE OF THE SUPERSTRUCTURE'S STRUCTURAL COMPONENTS AND SYSTEMS RELATING THERETO.

BUILDING DATA NOTES:

1. CONSTRUCTION IS TYPE V-B.
2. OCCUPANCY IS BUSINESS.
3. MEANS OF EGRESS IS DESIGNED FOR AN OCCUPANT LOAD OF 1 PERSON PER 100 SQUARE FEET OF GROSS FLOOR AREA. 15 TOTAL OCCUPANTS.
4. FIRE RATING OF EXTERIOR WALLS IS 0 HOURS.
5. THIS BUILDING REQUIRES A FIRE SEPARATION DISTANCE OF 10 FEET OR MORE IN ACCORDANCE WITH TABLE 602 OF THE IBC AND IS SUBJECT TO LOCAL JURISDICTION APPROVAL.

ILLINOIS STRUCTURAL LOAD LIMITATIONS:

FLOOR LIVE LOAD:
A. 100 PSF LOBBIES & CORRIDORS, 50 PSF ELSEWHERE.
B. 200% CONCENTRATED LOAD OVER 30 INCH X 30 INCH AREA LOCATED ANYWHERE ON FLOOR.

ROOF LIVE LOAD:
A. 20 PSF.

ROOF SNOW LOAD:
A. GROUND SNOW LOAD: $P_g = 30 \text{ PSF}$
B. PLAT-ROOF SNOW LOAD: $P_f = 23.1 \text{ PSF}$
C. SNOW EXPOSURE FACTOR: $C_e = 1.0$
D. SNOW IMPORTANCE FACTOR: $I_s = 1.0$
E. SNOW THERMAL FACTOR: $C_t = 1.1$
F. ROOF SLOPE FACTOR: $C_s = 1.0$
G. SLOPED ROOF SNOW LOAD: $P_s = P_f \times C_e$
H. DESIGN IS BASED ON FULL OR PARTIALLY EXPOSED ROOF PER ASCE 7-02.

WIND LOAD:
A. WIND SPEED (3-SEC GUST): $V = 90 \text{ MPH}$
B. WIND IMPORTANCE FACTOR: $I_w = 1.0$
C. WIND EXPOSURE CATEGORY: $EZ = C$
D. INTERNAL PRESSURE COEFFICIENT: $C_{pi} = 0.18$
E. COMPONENT & CLADDING PRESSURES (ROOF 0 TO 7 DEG):
WALL ZONE 5 = $+/-23.6 \text{ PSF}$
WALL ZONE 4 = $+/-19.1 \text{ PSF}$
ROOF ZONE 2 = -44.8 PSF
ROOF ZONE 1 = -28.8 PSF
ROOF ZONE 3 = -17.7 PSF
F. THIS BUILDING IS NOT DESIGNED FOR PLACEMENT ON THE UPPER HALF OF A HILL OR ESCARPMENT EXCEEDING 15 FEET IN HEIGHT.
G. BUILDING CATEGORY IS II PER ASCE 7-02.
H. BUILDING DESIGN IS BASED ON "TOLERABLE" CLASSIFICATION.
I. BUILDING MEAN ROOF HEIGHT SHALL NOT EXCEED 15 FEET.

SEISMIC LOAD:
A. SEISMIC IMPORTANCE FACTOR IS 1.0
B. SEISMIC OCCUPANCY CATEGORY IS II
C. SEISMIC SITE CLASS IS 0
D. SPECTRAL RESPONSE COEFFICIENTS:
 $S_a = 0.02$ $S_1 = 0.12$
 $S_0 = 0.48$ $S_2 = 0.10$
E. SEISMIC DESIGN CATEGORY IS C
F. SEISMIC FORCE RESISTING SYSTEM IS A12
G. SIMPLIFIED SEISMIC ANALYSIS PROCEDURE HAS BEEN USED.
H. RESPONSE MODIFICATION FACTOR $R = 6.5$.
I. SEISMIC RESPONSE COEFFICIENT $C_s = N/A$.
J. DESIGN BASE SHEAR $V = 3200\#$.

FLOOD LOAD:
THIS BUILDING IS NOT DESIGNED TO BE LOCATED IN A FLOOD HAZARD AREA.


CODE SUMMARY:

STATE	BUILDING	ELECTRICAL	MECHANICAL	PLUMBING	ACCESSIBILITY	ENERGY
ILLINOIS	2009 IBC	2002 NEC	2009 IMC	2004 ILLINOIS PLUMBING CODE	ILLINOIS & 2010 ADA	2012 IECC

APPROVED
RADCO
Apr 24, 2013
APPROVED

INDEX:

SHEET	DESCRIPTION
1 OF 7	COVER SHEET
2 OF 7	NOTES
3 OF 7	ELEVATIONS & END WALL BRACING
4 OF 7	FLOOR PLAN
5 OF 7	PLUMBING RISERS
6 OF 7	CROSS SECTION
7 OF 7	SITE HEADER DETAILS
1 OF 3	FOUNDATION NOTES
2 OF 3	FOUNDATION PLAN
3 OF 3	LONGITUDINAL THE DOWN



DIAMOND BUILDERS, INC.
440 THOMPSON DR. DOUGLAS GEORGIA 3154
678-384-7080 FAX: 678-384-5721

DATE: 04/15/2013	JAMES A. LICHY, R.A. dba ARCHETYPE DESIGN GROUP 8010 STATE LINE RD. #150 LEAWOOD, KS 66208	REVISIONS:	BY: JAL
SCALE: N/A			
CODES: SEE SUMMARY			
LABELS: RADCO, IL			
DBI 5540 A/B	24 X 60 BUSINESS		
BUILDING DESTINATION: JACKSONVILLE, IL			
COVER SHEET			
		PLAN NO. DBI 5540	1 OF 7

ELECTRICAL NOTES:

1. ALL EQUIPMENT SHALL BE LISTED BY UL FOR THE APPLICATION FOR WHICH IT IS USED AND ALL EQUIPMENT SHALL BE INSTALLED IN ACCORDANCE WITH THE LISTING.
2. ALL CIRCUITS AND EQUIPMENT SHALL BE GROUNDED IN ACCORDANCE WITH THE APPROPRIATE ARTICLES OF THE NATIONAL ELECTRICAL CODE (NEC). ALL EQUIPMENT SHALL BE LISTED AND IDENTIFIED FOR USE WITH 75°C OR 90°C CONDUCTORS UNLESS OTHERWISE SPECIFIED.
3. WHEN LIGHT FIXTURES ARE INSTALLED IN CLOSETS THEY SHALL BE SURFACE MOUNTED OR RECESSED. INCANDESCENT FIXTURES SHALL HAVE COMPLETELY ENCLOSED LAMPS. SURFACE MOUNTED INCANDESCENT FIXTURES SHALL HAVE A MINIMUM CLEARANCE OF 12 INCHES AND ALL OTHER FIXTURES SHALL BE A MINIMUM CLEARANCE OF 8 INCHES FROM "STORAGE AREA" AS DEFINED BY NEC 410-10(c).
4. WHEN WATER HEATERS ARE INSTALLED THEY SHALL BE PROVIDED WITH READILY ACCESSIBLE DISCONNECTS ADJACENT TO THE WATER HEATERS SERVED. THE BRANCH CIRCUIT SWITCH OR CIRCUIT BREAKER SHALL BE PERMITTED TO SERVE AS THE DISCONNECTING MEANS ONLY WHERE THE SWITCH OR CIRCUIT BREAKER IS WITHIN SIGHT FROM THE WATER HEATER OR IS CAPABLE OR BEING LOCKED IN THE OPEN POSITION.
5. HVAC EQUIPMENT SHALL BE PROVIDED WITH READILY ACCESSIBLE DISCONNECTS ADJACENT TO THE EQUIPMENT SERVED. A UNIT SWITCH WITH A MARKED "OFF" POSITION THAT IS A PART OF THE HVAC EQUIPMENT AND DISCONNECTS ALL UNGROUNDED CONDUCTORS SHALL BE PERMITTED AS THE DISCONNECTING MEANS WHERE OTHER DISCONNECTING MEANS ARE ALSO PROVIDED BY A READILY ACCESSIBLE CIRCUIT BREAKER.
6. PRIOR TO ENERGIZING THE ELECTRICAL SYSTEM THE INTERRUPTING RATING OF THE MAIN BREAKER MUST BE DESIGNED AND VERIFIED AS BEING IN COMPLIANCE WITH SECTION 110-9 OF THE NEC BY LOCAL ELECTRICAL CONSULTANT.
7. THE MAIN ELECTRICAL PANEL AND FEEDERS ARE DESIGNED BY OTHERS, SITE INSTALLED AND SUBJECT TO LOCAL JURISDICTION APPROVAL.
8. ALL CIRCUITS CROSSING OVER MODULE MATING LINE(S) SHALL BE SITE CONNECTED WITH APPROVED ACCESSIBLE JUNCTION BOXES OR CABLE CONNECTORS.
9. FIRE ALARM PULL STATION OPERABLE DEVICE SHALL BE LOCATED 42 TO 45 INCHES ABOVE THE FLOOR. FIRE ALARM HORN/STROBE DEVICE SHALL BE WALL MOUNTED WITH THE BOTTOM EDGE 80 INCHES ABOVE THE FLOOR.
10. ALL RECEPTACLES INSTALLED IN WET LOCATIONS (EXTERIOR) SHALL HAVE WEATHER PROOF (WP) ENCLOSURES. THE INTEGRITY OF WHICH IS NOT AFFECTED WHEN AN ATTACHMENT PLUG CAP IS INSERTED OR REMOVED. IN ADDITION NONLOCKING RECEPTACLES SHALL BE LISTED WEATHER-RESISTANT TYPE WHEN COMPLIANCE WITH THE 2011 NEC IS REQUIRED (SEE CODE SUMMARY ON COVER SHEET).
11. ALL EXTERIOR LIGHTS SHALL BE EQUIPPED WITH PHOTOCELLS FOR AUTOMATIC SHUT-OFF WHEN DAYLIGHT IS AVAILABLE.
12. EMERGENCY LIGHTING SHALL BE CAPABLE OF PROVIDING INITIAL ILLUMINATION THAT IS AT LEAST AN AVERAGE OF 1 FOOT-CANDLE (10) AND A MINIMUM OF 0.1 FC MEASURED ALONG THE PATH OF EGRESS AT THE FLOOR LEVEL. ILLUMINATION LEVELS SHALL BE PERMITTED TO DECLINE TO 0.6 FC AVERAGE AND A MINIMUM AT ANY POINT OF 0.06 FC AT THE END OF THE EMERGENCY LIGHT TIME DURATION. A MAXIMUM-TO-MINIMUM ILLUMINATION UNIFORMITY RATIO OF 40 TO 1 SHALL NOT BE EXCEEDED. THE EMERGENCY POWER SYSTEM SHALL PROVIDE POWER FOR A DURATION OF NOT LESS THAN 90 MINUTES.
13. WHEN A SINGLE RECEPTACLE IS INSTALLED ON AN INDIVIDUAL BRANCH CIRCUIT THE RECEPTACLE SHALL HAVE AN AMPERE RATING NOT LESS THAN THAT OF THE BRANCH CIRCUIT.
14. ELECTRICAL PANELS SHALL BE EQUIPPED WITH A MAIN BREAKER OF THE SAME SIZE AS THE PANEL UNLESS OTHERWISE SPECIFIED.
15. WIRING ABOVE T-GRID CEILING SHALL BE AC CABLE, MC CABLE OR RUN IN EMT CONDUIT.
16. NONMETALLIC CABLES SHALL BE SECURED AT 4 1/2 FEET ON CENTER MAXIMUM AND WITHIN 12 INCHES OF EACH BOX BY MEANS OF STAPLES, CABLE TIES, STRAPS, OR SIMILAR FITTINGS SO DESIGNED AND INSTALLED SO AS NOT TO DAMAGE THE CABLE. THE CABLE SHALL BE PROTECTED FROM PHYSICAL DAMAGE WHERE NECESSARY BY CONDUIT, GUARDS, OR OTHER MEANS.
17. WHERE CABLES ARE INSTALLED THROUGH BORED HOLES IN WOOD MEMBERS, THE HOLES SHALL BE SUCH THAT THE EDGE OF THE HOLE IS NOT LESS THAN 1/2 INCHES FROM THE NEAREST EDGE OF THE WOOD. WHERE THIS DISTANCE CANNOT BE MAINTAINED, THE CABLE SHALL BE PROTECTED FROM PENETRATION BY SCREWS OR NAILS BY A STEEL PLATE OR BUSHING AT LEAST 1/16 INCH THICK.

ELECTRICAL SCHEDULE 'A'			
CIRCUIT	NOMENCLATURE	BREAKER (AMPS)	WIRE (CU)
1,3A	HVAC	80 A (2P) HACR TYPE	8-8-10 MC +
2,5A	LIGHTING/FANS	15 A	14-2 MC
4,6A	RECEPTACLES	20 A	12-2 NM
ELECTRICAL PANEL SIZING:			
DESCRIPTION SUBPANEL 'A'		KVA	
GENERAL LIGHTING		0.035 KW/SF X 705 SF X 1.25=	3.1
20 RECEPTS AT 180VA/1000=			3.6
2 FAN AT .3 KW X 1.25=			1.1
HVAC			10.6
TOTAL 18.3 KW			
TOTAL/240 X 1000= 76.3 AMPS			
INSTALL 100 AMP PANEL & MAIN BREAKER			
200/240 V 1φ			

* INSULATION ON WIRING IN MC CABLE SHALL BE RATED FOR 90° C.

ELECTRICAL SCHEDULE 'B'			
CIRCUIT	NOMENCLATURE	BREAKER (AMPS)	WIRE (CU)
1,3B	WASH	80 A (2P) HACR TYPE	8-8-10 MC +
2B	LIGHTING	15 A	14-2 MC
4,5,6B	RECEPTACLES	20 A	12-2 NM
5B	WASHER	20 A (1P)	12-2 NM
7B	REFRIGERATOR	20 A (1P)	12-2 NM
9,11B	N/A	25 A (2P)	10-3 NM
10,12B	DRYER	30 A (2P)	10-3 NM
14,16B	DEDICATED	50 A (2P)	6-3 NM
15B	MICROWAVE	20 A (1P)	12-2 NM
13B	DISH WSH	20 A (1P)	12-2 NM
17B	DISH WASHER	20 A (1P)	12-3 NM

ELECTRICAL PANEL SIZING:		
DESCRIPTION	SUBPANEL 'B'	KVA
GENERAL LIGHTING		
0.035 KW/SF X 705 SF X 1.25=		3.1
20 RECEPTS AT 180VA/1000=		3.6
2 FAN AT .3 KW X 1.25=		0.0
WASHER		1.5
HVAC		10.6
REFRIGERATOR		5.0
DRYER		3.6
DEDICATED		1.2
MICROWAVE		1.2
CARBIDE DISPOSAL		1.2
DISH WASHER		1.2
TOTAL 42.9 KW		
TOTAL/240 X 1000= 178.8 AMPS		
INSTALL 200 AMP PANEL & MAIN BREAKER		
120/240 V 1φ		

PLUMBING NOTES:

1. WHEN REQUIRED RESTROOM FACILITIES ARE NOT PROVIDED WITHIN THE BUILDING THEY SHALL BE LOCATED IN AN ADJACENT BUILDING OR SITE INSTALLED AND BE SUBJECT TO THE APPROVAL AND INSPECTION BY THE JURISDICTION HAVING AUTHORITY. ALL SITE INSTALLED FACILITIES ARE DESIGNED BY OTHERS. THIS SHALL BE NOTED ON THE BUILDING DATA PLATE.
2. BUILDING OWNER ASSUMES ALL RESPONSIBILITY FOR DRINKING WATER FACILITIES, SERVICE SINK AND ALL OTHER REQUIRED PLUMBING FACILITIES NOT SHOWN ON FLOOR PLAN. ALL BUILDING OWNER PROVIDED FACILITIES ARE DESIGNED BY OTHERS. BOTTLED WATER MUST BE COMMERCIALY SEALED IN ACCORDANCE WITH THE ILLINOIS BOTTLED WATER ACT (815 ILCS 310).
3. TOILETS SHALL BE ELONGATED WITH NONABSORBENT OPEN FRONT SEATS.
4. RESTROOM WALLS SHALL BE COVERED WITH NONABSORBENT MATERIAL TO A MINIMUM HEIGHT OF 48 INCHES A.F.F. (70 INCHES MINIMUM IN SHOWERS). TOILET, BATHING AND SHOWER ROOM FLOORS SHALL HAVE A SMOOTH, HARD, NONABSORBENT SURFACE THAT EXTENDS UPWARD ONTO THE WALLS AT LEAST 4 INCHES.
5. ALL PLUMBING FIXTURES SHALL HAVE SEPARATE SHUTOFF VALVES.
6. WATER HEATER SHALL HAVE A T & P RELIEF VALVE WITH DRAIN TO EXTERIOR, AND A SHUTOFF VALVE WITHIN 3 FEET OF THE COLD WATER SUPPLY LINE.
7. DWV SYSTEM SHALL BE EITHER ABS OR PVC - DWV.
8. WATER SUPPLY LINES SHALL BE CPVC OR COPPER.
9. ALL PIPE HANGERS SHALL BE NON-METALLIC OR OF THE SAME METAL AS THE PIPE BEING SUPPORTED. ALL SUPPORTS FOR PLASTIC PIPES SHALL PERMIT FREE MOVEMENT AND/OR THERMAL EXPANSION OF THE PIPE. PIPING SUPPORTS SHALL BE SPACED IN ACCORDANCE WITH THE APPLICABLE PLUMBING CODE AND MANUFACTURER'S INSTALLATION INSTRUCTIONS. HANGERS SHALL BE OF SUFFICIENT STRENGTH TO SUPPORT THE PIPING WHEN FULL AND SHALL BE SECURED AND FASTENED TO STRUCTURAL MEMBERS. HANGERS AND STRAPS USED TO SUPPORT PLASTIC PIPING SHALL NOT COMPRESS, DISTORT, CUT, OR ABRADE THE PIPING AND SHALL ALLOW FREE MOVEMENT OF THE PIPE. VERTICAL PLASTIC PIPING SHALL BE MAINTAINED IN STRAIGHT ALIGNMENT WITH SUPPORTS AT EACH FLOOR LEVEL OR AT INTERVALS OF TEN FEET, WHICHEVER IS LESS. ALL HORIZONTAL PLASTIC PIPING SHALL BE SUPPORTED AS CLOSE AS POSSIBLE TO TRAP. COPPER TUBING SHALL BE SUPPORTED AT INTERVALS OF 8 FEET MAXIMUM.
10. WATER PIPES INSTALLED IN A WALL EXPOSED TO THE EXTERIOR SHALL BE LOCATED ON THE HEATED SIDE OF THE WALL INSULATION. WATER PIPING INSTALLED IN AN UNCONDITIONED ATTIC SHALL BE INSULATED WITH AN INSULATION OF R-8.5 MINIMUM, WHERE SUBJECT TO TEMPERATURES LESS THAN 32° F. WATER, SOIL OR WASTE PIPES SHALL BE INSULATED WITH AN INSULATION OF R-6.5 MINIMUM.
11. WATER CLOSETS ARE TANK TYPE AND URINALS ARE FLUSH TANK TYPE UNLESS OTHERWISE SPECIFIED.
12. BUILDING DRAIN AND CLEANOUTS ARE DESIGNED AND SITE INSTALLED BY OTHERS, SUBJECT TO LOCAL JURISDICTION APPROVAL.
13. THERMAL EXPANSION DEVICE, IF REQUIRED BY WATER HEATER INSTALLED, AND IF NOT SHOWN ON PLUMBING PLAN, IS DESIGNED AND SITE INSTALLED BY OTHERS, SUBJECT TO LOCAL APPROVAL.
14. WATER HEATER STORAGE TANKS SHALL HAVE THE FIRST 8 FEET OF OUTLET PIPING AND THE INLET PIPE BETWEEN THE TANK AND THE HEAT TRAP COVERED WITH 1 INCH THICK INSULATION FOR PIPE DIAMETERS OF 2 INCH OR LESS, AND 1.5 INCH THICK INSULATION FOR PIPE DIAMETERS GREATER THAN 2 INCH. WATER HEATER RELIEF VALVE MUST DRAIN TO A TRAPPED AND VENTED DRAIN.
15. A WATER-HAMMER ARRESTOR SHALL BE INSTALLED WHERE QUICK-CLOSING VALVES ARE UTILIZED, UNLESS OTHERWISE APPROVED. WATER-HAMMER ARRESTORS SHALL BE INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S SPECIFICATIONS. WATER-HAMMER ARRESTORS SHALL CONFORM TO ASSE 1010. WATER HAMMER PROTECTION SHALL BE PROVIDED IN THE LAVATORY FIXTURE SUPPLY BY MEANS OF AN AIR CHAMBER AT LEAST 12 INCHES IN LENGTH AND THE SAME DIAMETER AS THE FIXTURE SUPPLY, OR BY A WATER HAMMER ARRESTOR INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S SPECIFICATIONS.
16. SHOWERS SHALL BE CONTROLLED BY AN APPROVED MIXING VALVE WITH A MAXIMUM WATER OUTLET TEMPERATURE OF 110°F (43°C).
17. TEMPERED WATER SHALL BE DELIVERED FROM LAVATORIES IN PUBLIC TOILET FACILITIES. TEMPERED WATER SHALL BE DELIVERED THROUGH AN APPROVED WATER-TEMPERATURE LIMITING DEVICE THAT CONFORMS TO ANSI/ASSE 1016-1996 OR 1017-1998 AND SHALL LIMIT THE TEMPERED WATER TO A MAXIMUM OF 110°F (43°C).

MECHANICAL NOTES:


1. ALL SUPPLY AIR REGISTERS SHALL BE 24 INCHES X 24 INCHES ADJUSTABLE WITH 8 INCHES X 20 INCHES (INSIDE) OVERHEAD FIBERGLASS MAIN DUCT, AND 8 INCH X 16 INCH (INSIDE) OVERHEAD FIBERGLASS STEP DOWN MAIN DUCT. DUCTS LOCATED OUTSIDE THE BUILDING ENVELOPE INCLUDING ATTIC DUCTS LOCATED ABOVE CEILING INSULATION SHALL HAVE R-8 MINIMUM INSULATION VALUE. DUCTS LOCATED IN UNCONDITIONED SPACES INCLUDING ATTIC DUCTS LOCATED BELOW CEILING OR ROOF INSULATION SHALL HAVE R-5 MINIMUM INSULATION VALUE. AT T-GRID CEILINGS THE FLEX DUCT FROM MAIN SUPPLY AIR DUCT TO SUPPLY AIR REGISTERS SHALL BE 8" (INSIDE) AND THE FLEX DUCT FROM MAIN RETURN AIR DUCT TO RETURN AIR REGISTERS SHALL BE 10" (INSIDE) UNLESS OTHERWISE SPECIFIED.
2. FIBERGLASS DUCTS SHALL BE CONSTRUCTED WITH CLASS 0 OR CLASS 1 DUCT MATERIAL IN ACCORDANCE WITH UL 181. FIBERGLASS DUCT CONSTRUCTION AND INSTALLATION SHALL CONFORM TO THE SHACMA FIBROUS GLASS DUCT CONSTRUCTION STANDARDS OR NAAMA FIBROUS GLASS DUCT CONSTRUCTION STANDARDS. METAL DUCTS SHALL BE CONSTRUCTED AS SPECIFIED IN THE SHACMA HVAC DUCT CONSTRUCTION STANDARDS - METAL AND FLEXIBLE. FLEXIBLE AIR DUCTS, BOTH FIBERGLASS AND METAL, SHALL BE TESTED IN ACCORDANCE WITH UL 181 AND SHALL BE LISTED AND LABELED AS CLASS 0 OR CLASS 1 FLEXIBLE AIR DUCT. ALL DUCTS SHALL BE INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S INSTALLATION INSTRUCTIONS.
3. INTERIOR DOORS SHALL BE UNDERCUT 1.5 INCHES ABOVE FINISHED FLOOR FOR AIR RETURN AND OR AS NOTED ON FLOOR PLAN, EXCEPT DOORS LOCATED IN FIRE RATED PARTITIONS SHALL NOT BE UNDERCUT.
4. RESTROOM VENT FANS SHALL PROVIDE 75 CFM OR MORE EXHAUST PER WATER CLOSET OR URINAL, UNLESS OTHERWISE SPECIFIED ON PLANS.
5. VENT FANS SHALL BE DUCTED TO THE EXTERIOR AND TERMINATE AT AN APPROVED VENT CAP.
6. HVAC EQUIPMENT SHALL BE EQUIPPED WITH OUTSIDE FRESH AIR INTAKES CAPABLE OF PROVIDING 250 CFM FOR EACH UNIT.
7. HVAC SYSTEM SHALL COMPLY WITH NFPA 90B.
8. THERMOSTATS SHALL BE PROGRAMMABLE AS REQUIRED BY THE APPLICABLE ENERGY CODE. IF PROGRAMMABLE THERMOSTATS ARE NOT INSTALLED IN THE FACTORY THEY SHALL BE PROVIDED BY THE BUILDING OWNER AND SITE INSTALLED BY OTHERS.

CLOTHES DRYER EXHAUST NOTES:

1. CLOTHES DRYER IS ASSUMED TO BE A DOMESTIC TYPE CLOTHES DRYER.
2. CLOTHES DRYER SHALL BE EXHAUSTED IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS.
3. CLOTHES DRYER EXHAUST SHALL BE DUCTED THROUGH THE CRAWLSPACE TO THE OUTSIDE OF THE BUILDING AND SHALL BE EQUIPPED WITH A BACKDRIFT DAMPER.
4. WHERE EXHAUST DUCT PENETRATES A WALL MEMBRANE, THE ANNULAR SPACE SHALL BE SEALED WITH NONCOMBUSTIBLE MATERIAL, APPROVED FIRE CULKING OR A NONCOMBUSTIBLE DRYER EXHAUST DUCT WALL RECEPTACLE.
5. DUCT VERTICAL RISERS SHALL BE PROVIDED WITH A MEANS FOR CLEANOUT.
6. EXHAUST DUCT SHALL BE 4 INCH NOMINAL IN DIAMETER AND SHALL HAVE A SMOOTH FINISH AND SHALL BE CONSTRUCTED OF 0.016 INCH MINIMUM METAL.
7. EXHAUST DUCT SHALL BE SECURED AT 4-FOOT INTERVALS AND SECURED IN PLACE.
8. PROTECTIVE SHIELD PLATES SHALL BE PLACED WHERE NAILS OR SCREWS FROM FINISH OR OTHER WORK ARE LIKELY TO PENETRATE THE CLOTHES DRYER EXHAUST DUCT. SEE MPC SECTION 504.6.7 FOR SHIELD PLATE REQUIREMENTS.
9. JOINTS IN DUCTWORK SHALL BE MADE WITH MECHANICAL FASTENERS AND SEALED WITH UL LISTED TAPE OR MASTIC IN ACCORDANCE WITH SHACMA GUIDELINES.

SYMBOLS

	SMOKE DETECTOR		PROGRAMMABLE THERMOSTAT
	DUPLEX RECEPTACLE 120 V.		FLUORESCENT FIXTURE WITH 3-32W T8 TUBES & ELECTRONIC BALLAST (96 W. TOTAL FIXTURE WATTAGE)
	DUPLEX RECEPTACLE 120 V. 40 INCHES A.F.F.		FLUORESCENT FIXTURE WITH 2-32W T8 TUBES & ELECTRONIC BALLAST (61 W. TOTAL FIXTURE WATTAGE)
	SINGLE RECEPTACLE 240 V.		COMBO INTERNALLY LIGHTED EXIT SIGN (5 W.) & EMERGENCY LIGHT WITH BATTERY BACKUP
	SWITCH/ 3 WAY & DIMMER SWITCH		JUNCTION BOX (NON POWERED UNLESS CIRCUIT NO. IS SHOWN)
	EXTERIOR INCANDESCENT LIGHT WITH 1- 80 W. BULB		POWERED JUNCTION BOX (200 WATTS MAX.)
	VENT FAN		EMERGENCY LIGHT WITH BATTERY BACKUP
	SUPPLY AIR REGISTER		
	RETURN AIR REGISTER		



DIAMOND BUILDERS, INC.
440 THOMPSON DR. DOUGLAS GEORGIA 3154
(770) 284-7080 FAX: (770) 284-5721


DATE: 04/15/2013	JAMES A. LICHTY, R.A. dba ARCHITYPE DESIGN GROUP 8010 STATE LINE Rd. #150 LEAWOOD, KS 66208	BY: JAL
SCALE: N/A	REVISIONS:	SHEET
CODES: SEE SUMMARY		2 OF 7
LABELS: RADCO, IL		
DBI 5540 A/B 24 X 60 BUSINESS		
ELECTRICAL, MECHANICAL & PLUMBING NOTES		PLAN NO. DBI 5540

APPROVED


RADCO

Apr 24, 2013


APPROVED

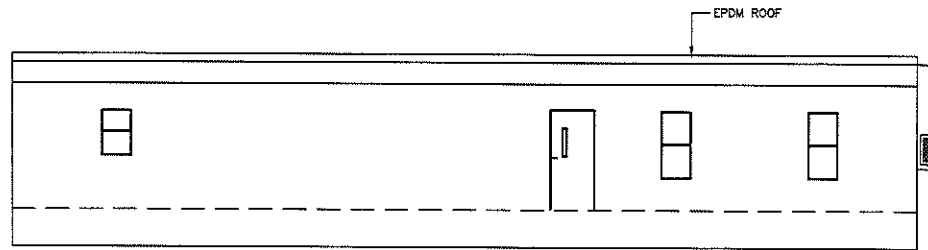


FRONT ELEVATION

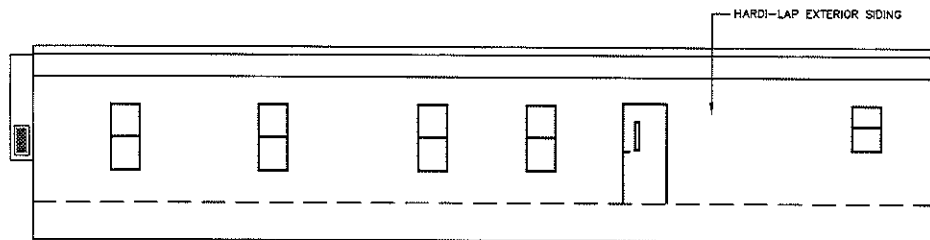

REAR ELEVATION

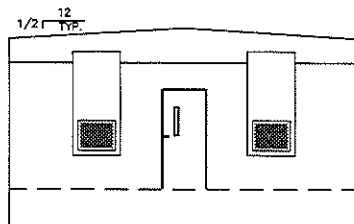


RIGHT ELEVATION

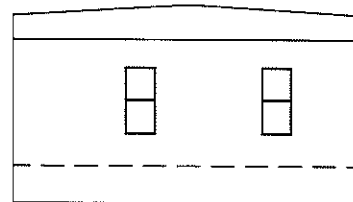


LEFT ELEVATION

TYPICAL ELEVATION NOTES:


1. ALL SITE INSTALLED ITEMS ARE SUBJECT TO THE APPROVAL OF THE JURISDICTION HAVING AUTHORITY.
2. ACCESSIBLE RAMP(S), STAIR(S), AND HANDRAILS ARE DESIGNED BY OTHERS AND SITE INSTALLED.
3. FOUNDATION ENCLOSURE (IF PROVIDED) IS DESIGNED BY OTHERS AND SITE INSTALLED. ENCLOSURE MUST HAVE A MINIMUM NET AREA OF VENTILATION OPENINGS OF NOT LESS THAN ONE SQUARE FOOT FOR EACH 150 SQUARE FEET OF CRAWL SPACE AREA. LOCATE OPENINGS TO PROVIDE CROSS VENTILATION OF ENTIRE CRAWL SPACE. INSTALL AN 18" X 24" MINIMUM OPENING FOR CRAWL SPACE ACCESS.

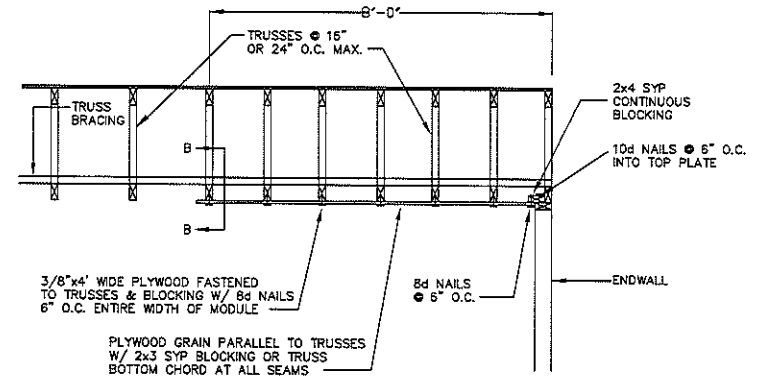

SECTION A-A
(TYP. EACH ENDWALL)

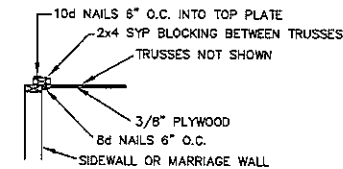


SECTION B-B
(TYP. EACH SIDEWALL & MARRIAGE WALL)

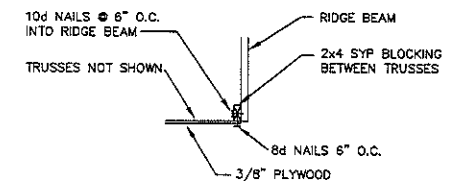


SECTION B-B
(TYP. AT RIDGE BEAM)

APPROVED **RADCO** APPROVED
Apr 24, 2013



DIAMOND BUILDERS, INC.			
440 THOMPSON DR., DOUGLAS GEORGIA 3154			
678384-7080 FAX: 678384-5721			
DATE: 04/15/2013	JAMES A. LIGHTY, R.A. dba ARCHETYPE DESIGN GROUP 8010 STATE LINE Rd. #150 LEAWOOD, KS 66208		
SCALE: NTS	REVISIONS:		
CODES: SEE SUMMARY	REVISED:		
LABELS: RADCO, IL	BY: JAL		
DBI 5540 A/B	24 x 60	BUSINESS	SHEET
ELEVATIONS & END WALL BRACING			3 OF 7
PLAN NO. DBI 5540			

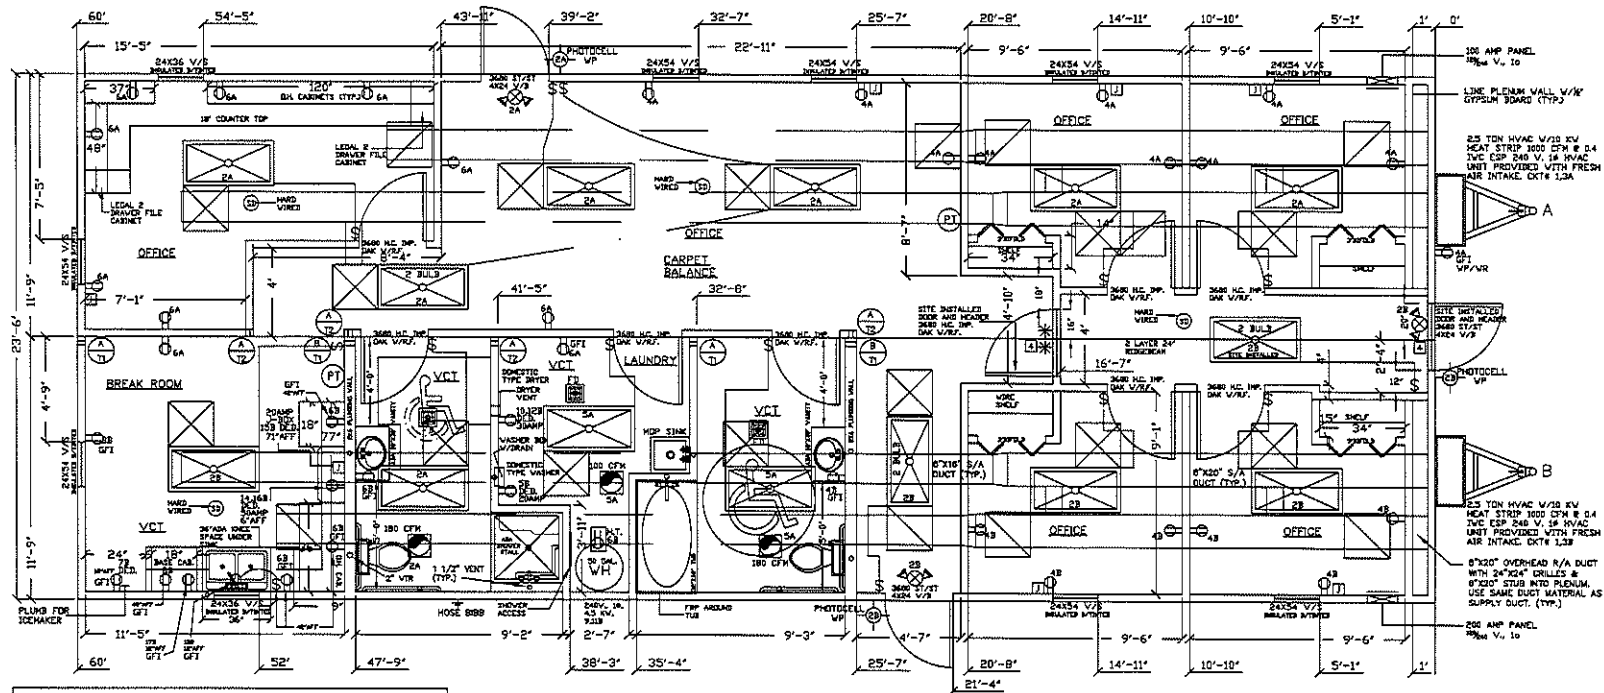

NOTE:
THE BREAK ROOM AREA IS NOT DESIGNED FOR USE AS A COMMERCIAL FOOD SERVICE ESTABLISHMENT HOWEVER ANY APPLIANCES INSTALLED ARE SUBJECT TO THE APPLICABLE VENTILATION AND EXHAUST REQUIREMENTS OF THE APPLICABLE CODES. ANY AND ALL EXHAUST REQUIREMENTS, AS DETERMINED BY THE JURISDICTION HAVING AUTHORITY, ARE DESIGNED BY OTHERS AND SITE INSTALLED BY OTHERS AND SUBJECT TO THE APPROVAL OF THE JURISDICTION HAVING AUTHORITY.

COLUMN & COLUMN STRAPPING LEGEND

- (B) INDICATES TYPE OF STUD
- (T2) INDICATES TYPE OF TIE DOWN STRAP
- *
- INDICATES WITH RIDGE BEAM BEARING STIFFENER (SEE RIDGE BEAM NOTES FOR SPECIFICATIONS)

COLUMN DESCRIPTIONS

A (2) 2x4 SYP #2 THIS HALF. B (2) 2x6 SYP #2 THIS HALF

NOTES:

1. ALL COLUMN STUDS SHALL BE NAILED TOGETHER PER NDS AND FASTENED TOGETHER WITH 100% PVA GLUE COVERAGE.
2. COLUMN STUDS SHALL NOT BE NOTCHED OR BORED.
3. INSTALL ONE TIE DOWN STRAP FROM RIDGE BEAM TO COLUMN AND FROM COLUMN TO FLOOR RIM JOIST FOR EACH STUD OF COLUMN. (IE: 4 STUD COLUMN WILL REQUIRE 4 TIE DOWN STRAPS)
4. STRAPS SHALL NOT BE OVERLAPPED OR DOUBLED UNLESS SPECIFIED OTHERWISE.


TIE DOWN STRAP DESCRIPTIONS

- T1 20 GA X 1-1/2" GALV. STEEL STRAP WITH (6) 0.148" X 3" NAILS EACH END. TWO 20 GA X 1-1/2" GALV. STEEL STRAPS MAY BE SUBSTITUTED FOR ONE 20 GA X 1-1/2" STRAP. NAILS MUST PENETRATE 2" MINIMUM INTO ALL MEMBERS. PENETRATION MAY BE REDUCED TO 1-1/2" IF 8 NAILS ARE USED IN LIEU OF 6. IN NO CASE SHALL SPLITTING OF WOOD BE PERMITTED.
- T2 26 GA X 1-1/2" GALV. STEEL STRAP WITH (6) 14 GA X 7/16" X 1" STAPLES EACH END. 15 GA STAPLES MAY BE USED IF QUANTITY IS INCREASED TO (7) STAPLES.


APPROVED

RADCO
Apr 24, 2013


APPROVED



DIAMOND BUILDERS, INC. 440 THOMPSON DR. DOUGLAS GEORGIA 3134 (678)384-7080 FAX: (678)384-5721			
DATE: 04/15/2013	JAMES A. LIGHTY, R.A. dba ARCHETYPE DESIGN GROUP 8010 STATE LINE RD. #150 LEAWOOD, KS 66208		
SCALE: 3/16" = 1'-0"	CODES: SEE SUMMARY	REVISIONS:	BY: JAL
LABELS: RADCO, IL			
DBI 5540 A/B	24 X 60	BUSINESS	SHEET 4 OF 7
FLOOR PLAN	PLAN NO. DBI 5540		



(a)
tub elevation

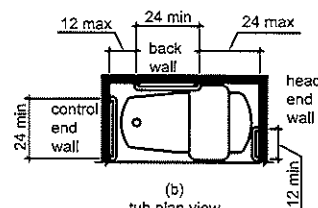

(b)
tub plan view

ACCESSIBILITY NOTES FOR BATHTUB:

1. ACCESSIBLE BATHTUB SHALL BE EQUIPPED WITH A REMOVABLE IN-TUB SEAT. THE TOP OF THE BATHTUB SEAT SHALL BE 17 INCHES MINIMUM AND 19 INCHES MAXIMUM ABOVE THE BATHROOM FLOOR FINISH. THE SEAT DEPTH SHALL BE 15 INCHES MINIMUM AND 16 INCHES MAXIMUM. THE SEAT SHALL BE CAPABLE OF SECURE PLACEMENT.
2. BACK WALL OF BATHTUB SHALL HAVE TWO HORIZONTAL GRAB BARS, ONE SHALL BE 8 INCHES MINIMUM AND 10 INCHES MAXIMUM ABOVE THE RIM OF THE BATHTUB AND THE OTHER SHALL BE 33 INCHES MINIMUM AND 36 INCHES MAXIMUM ABOVE THE FINISH FLOOR MEASURED TO THE TOP OF THE GRIPPING SURFACE.
3. CONTROL END WALL SHALL HAVE ONE HORIZONTAL GRAB BAR 24 INCHES LONG MINIMUM INSTALLED AT THE FRONT EDGE OF THE BATHTUB.
4. HEAD END WALL SHALL HAVE ONE HORIZONTAL GRAB BAR 12 INCHES LONG INSTALLED AT THE FRONT EDGE OF THE BATHTUB.
5. CONTROLS SHALL BE BETWEEN THE BATHTUB RIM AND GRAB BAR, AND BETWEEN THE OPEN SIDE OF THE BATHTUB AND THE CENTERLINE OF THE WIDTH OF THE BATHTUB.
6. A SHOWER SPRAY UNIT WITH A HOSE AT LEAST 59 INCHES LONG THAT CAN BE USED BOTH AS A FIXED SHOWER HEAD AND AS A HAND-HELD SHOWER SHALL BE PROVIDED. SHOWER SPRAY CONTROL SHALL BE EQUIPPED WITH AN ON/OFF CONTROL WITH A NON-POSITIVE SHUT-OFF AND SHALL MAINTAIN TEMPERATURE TO 110°F (43°C). IF AN ADJUSTABLE HEIGHT SHOWER HEAD ON A VERTICAL BAR IS USED, THE BAR SHALL BE INSTALLED SO AS NOT TO OBSTRUCT THE USE OF THE GRAB BARS.
7. ENCLOSURE FOR BATHTUB SHALL NOT OBSTRUCT CONTROLS, FAUCETS, SHOWER AND SPRAY UNITS OR OBSTRUCT TRANSFER FROM WHEELCHAIR ONTO BATHTUB SEAT OR INTO BATHTUB. ENCLOSURE ON BATHTUB SHALL NOT HAVE TRACTS INSTALLED ON THE RIM OF THE OPEN FACE OF THE BATHTUB.

SUPPLY LINE NOTES:

1. SUPPLY LINE SIZING IS BASED ON AN ASSUMED AVAILABLE PRESSURE OF 50 PSI TO 60 PSI AT THE LOCATION OF THE INLET(S) SHOWN AFTER ANY DEDUCTIONS FOR WATER PRESSURE REDUCING VALVES OR SPECIAL EQUIPMENT SUCH AS BACKFLOW PREVENTOR, FILTER, SOFTENER, ETC. THIS AVAILABLE PRESSURE MUST BE VERIFIED PRIOR TO CONSTRUCTION.
2. SUPPLY LINE INLET(S) SHOWN ON THESE PLANS ARE ASSUMED TO EXTEND ONLY TO EXTERIOR WALL. ALL SERVICE SUPPLY LINES UP TO THE INLET(S) ARE DESIGNED BY OTHERS AND SITE INSTALLED UNLESS OTHERWISE SPECIFIED.
3. SUPPLY LINE SIZING MUST BE REDESIGNED IF THE BUILDING DOES NOT COMPLY WITH ANY OF THE ABOVE ASSUMPTIONS.
4. UNLESS OTHERWISE SPECIFIED ALL SUPPLY LINES ARE 3/4" AND ALL STUB-UPS ARE 1/2".
5. LAV FAUCETS SHALL BE SELF-CLOSING.

— COLD
--- HOT

GENERAL NOTES:

1. ALL PLUMBING BELOW FLOOR IS SITE INSTALLED.
2. FD = FLOOR DRAIN WITH TRAP PRIMER AND REMOVABLE STRAINER. IF TRAP PRIMER CONNECTS TO A POTABLE WATER SUPPLY THEN A BACK FLOW PREVENTOR SHALL BE INSTALLED ON THE PRIMER SUPPLY LINE.
3. P-TRAPS SHALL BE REMOVABLE TO ALLOW DRAIN LINE CLEANOUT.
4. MAXIMUM FIXTURE TRAP TO VENT DISTANCES:
1 1/2" TRAP = 3'-6"
2" TRAP = 4'-0"
3" TRAP = 5'-0"
5. BUILDING MAIN DRAIN TO SEWER SHALL BE 4".


DEMAND LOAD CALCULATION

SUPPLY FIXTURE UNITS (SFU)	
2 WC X 5 SFU	= 10
2 LAV X 2 SFU	= 4
1 MOP SINK X 3 SFU	= 3
1 TUB X 4 SFU	= 4
1 WASHER X 3 SFU	= 3
1 SHOWER X 4 SFU	= 4
1 H.B. X 2 SFU	= 2

TOTAL SFU = 30




DEMAND = 23.3 GPM

1-1/4" INLET --- O.K.

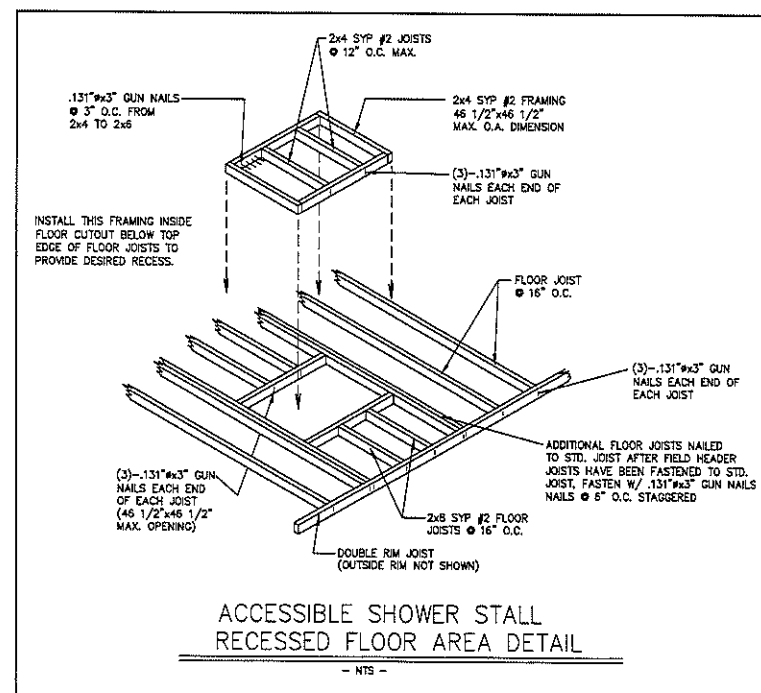

ACCESSIBLE SHOWER STALL RECESSED FLOOR AREA DETAIL


- NTS -

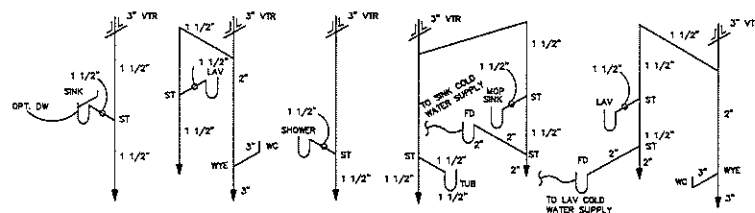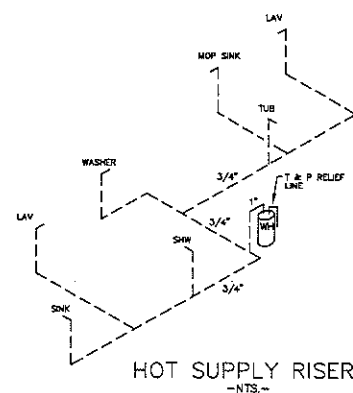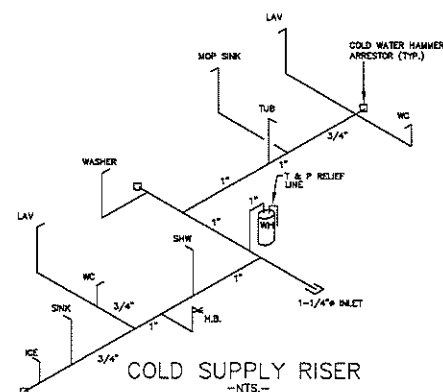


DWV RISERS - NTS. -

NOTE:
ALL 3" VTR'S SHALL EXTEND 12" MIN.
BELOW ROOF LINE. CHANGE IN SIZE
SHALL BE MADE WITH A LONG INCREASER.


APPROVED
RADCO
Apr 24, 2013
APPROVED



DIAMOND BUILDERS, INC. 440 THOMPSON DR. DOUGLAS GEORGIA 3154 (912) 384-7080 FAX: (912) 384-5721			
DATE: 04/15/2013	JAMES A. LICHTY, R.A. dba ARCHETYPE DESIGN GROUP 8010 STATE LINE Rd. #150 LEAWOOD, KS 66208		
SCALE: NTS	REVISIONS:	BY: JAL	
CODES: SEE SUMMARY	REVISED:		
LABELS: RADCO, IL	SHEET 5 OF 7		
DEI 5540 A/B	24 X 60	BUSINESS	PLAN NO. DEI 5540
PLUMBING RISERS AND DETAILS			

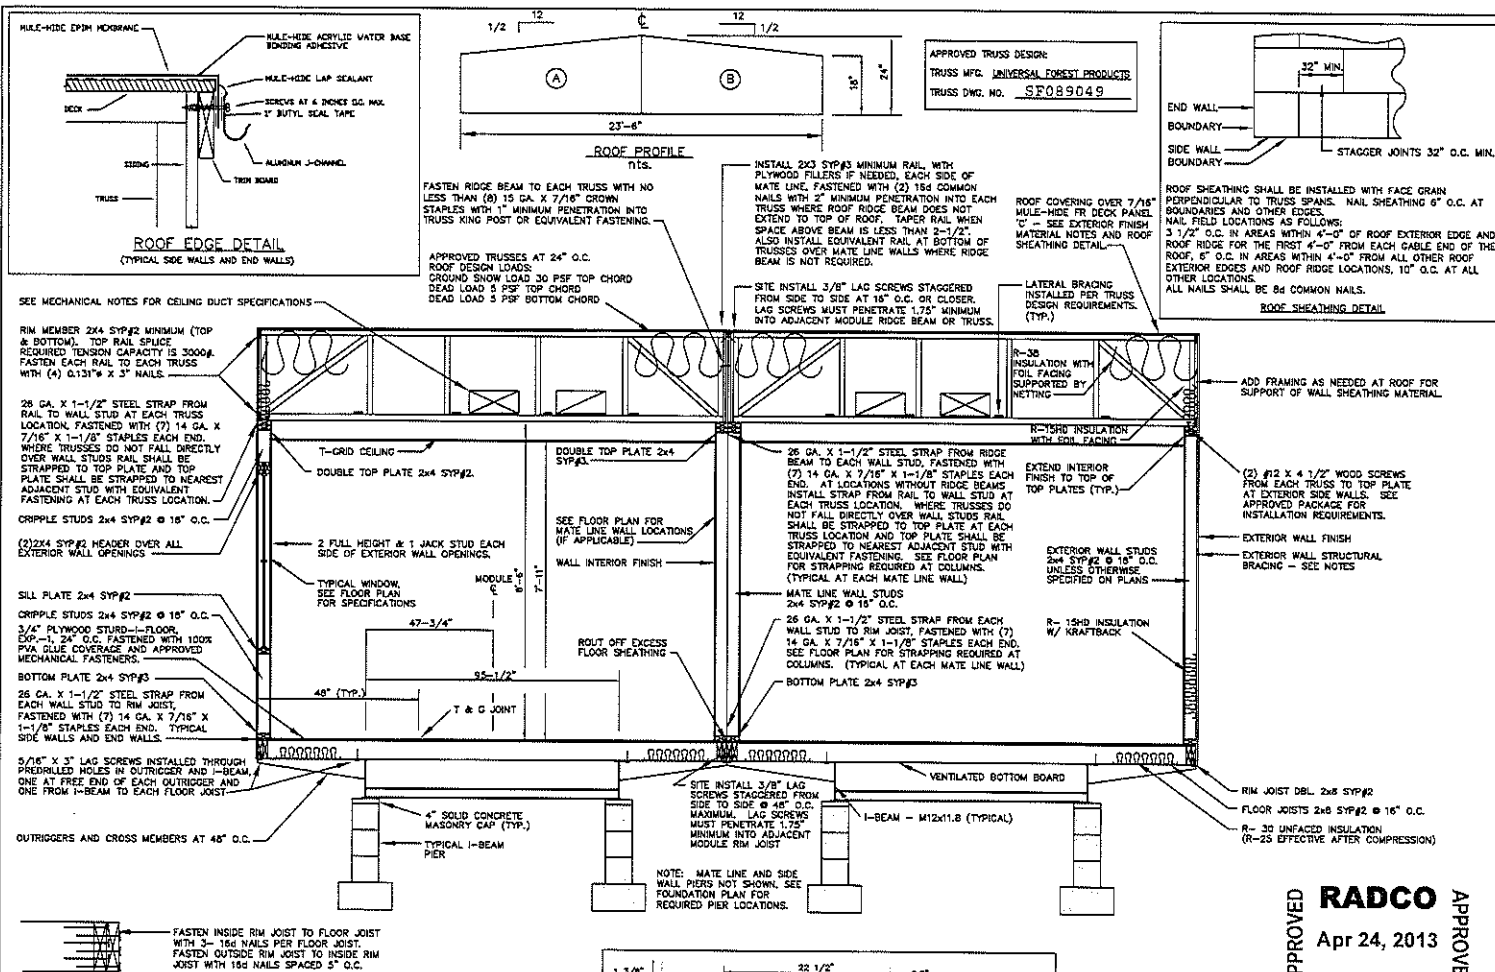

APPROVED
RADCO
Apr 24, 2013
APPROVED



DIAMOND BUILDERS, INC.			
440 THOMPSON DR. DOUGLAS GEORGIA 31534			
(678)284-7080 FAX: (678)284-5721			
DATE: 04/15/2013	JAMES A. LICHITY, R.A.	BY:	JAL
SCALE: NTS	dba ARCHETYPE DESIGN GROUP		
CODES: SEE SUMMARY	8010 STATE LINE RD. #150		
LABELS: RADCO, IL	LEAWOOD, KS 68208		
DBI 5540 A/B	24 X 60	BUSINESS	SHEET
CROSS SECTION			6 OF 7

